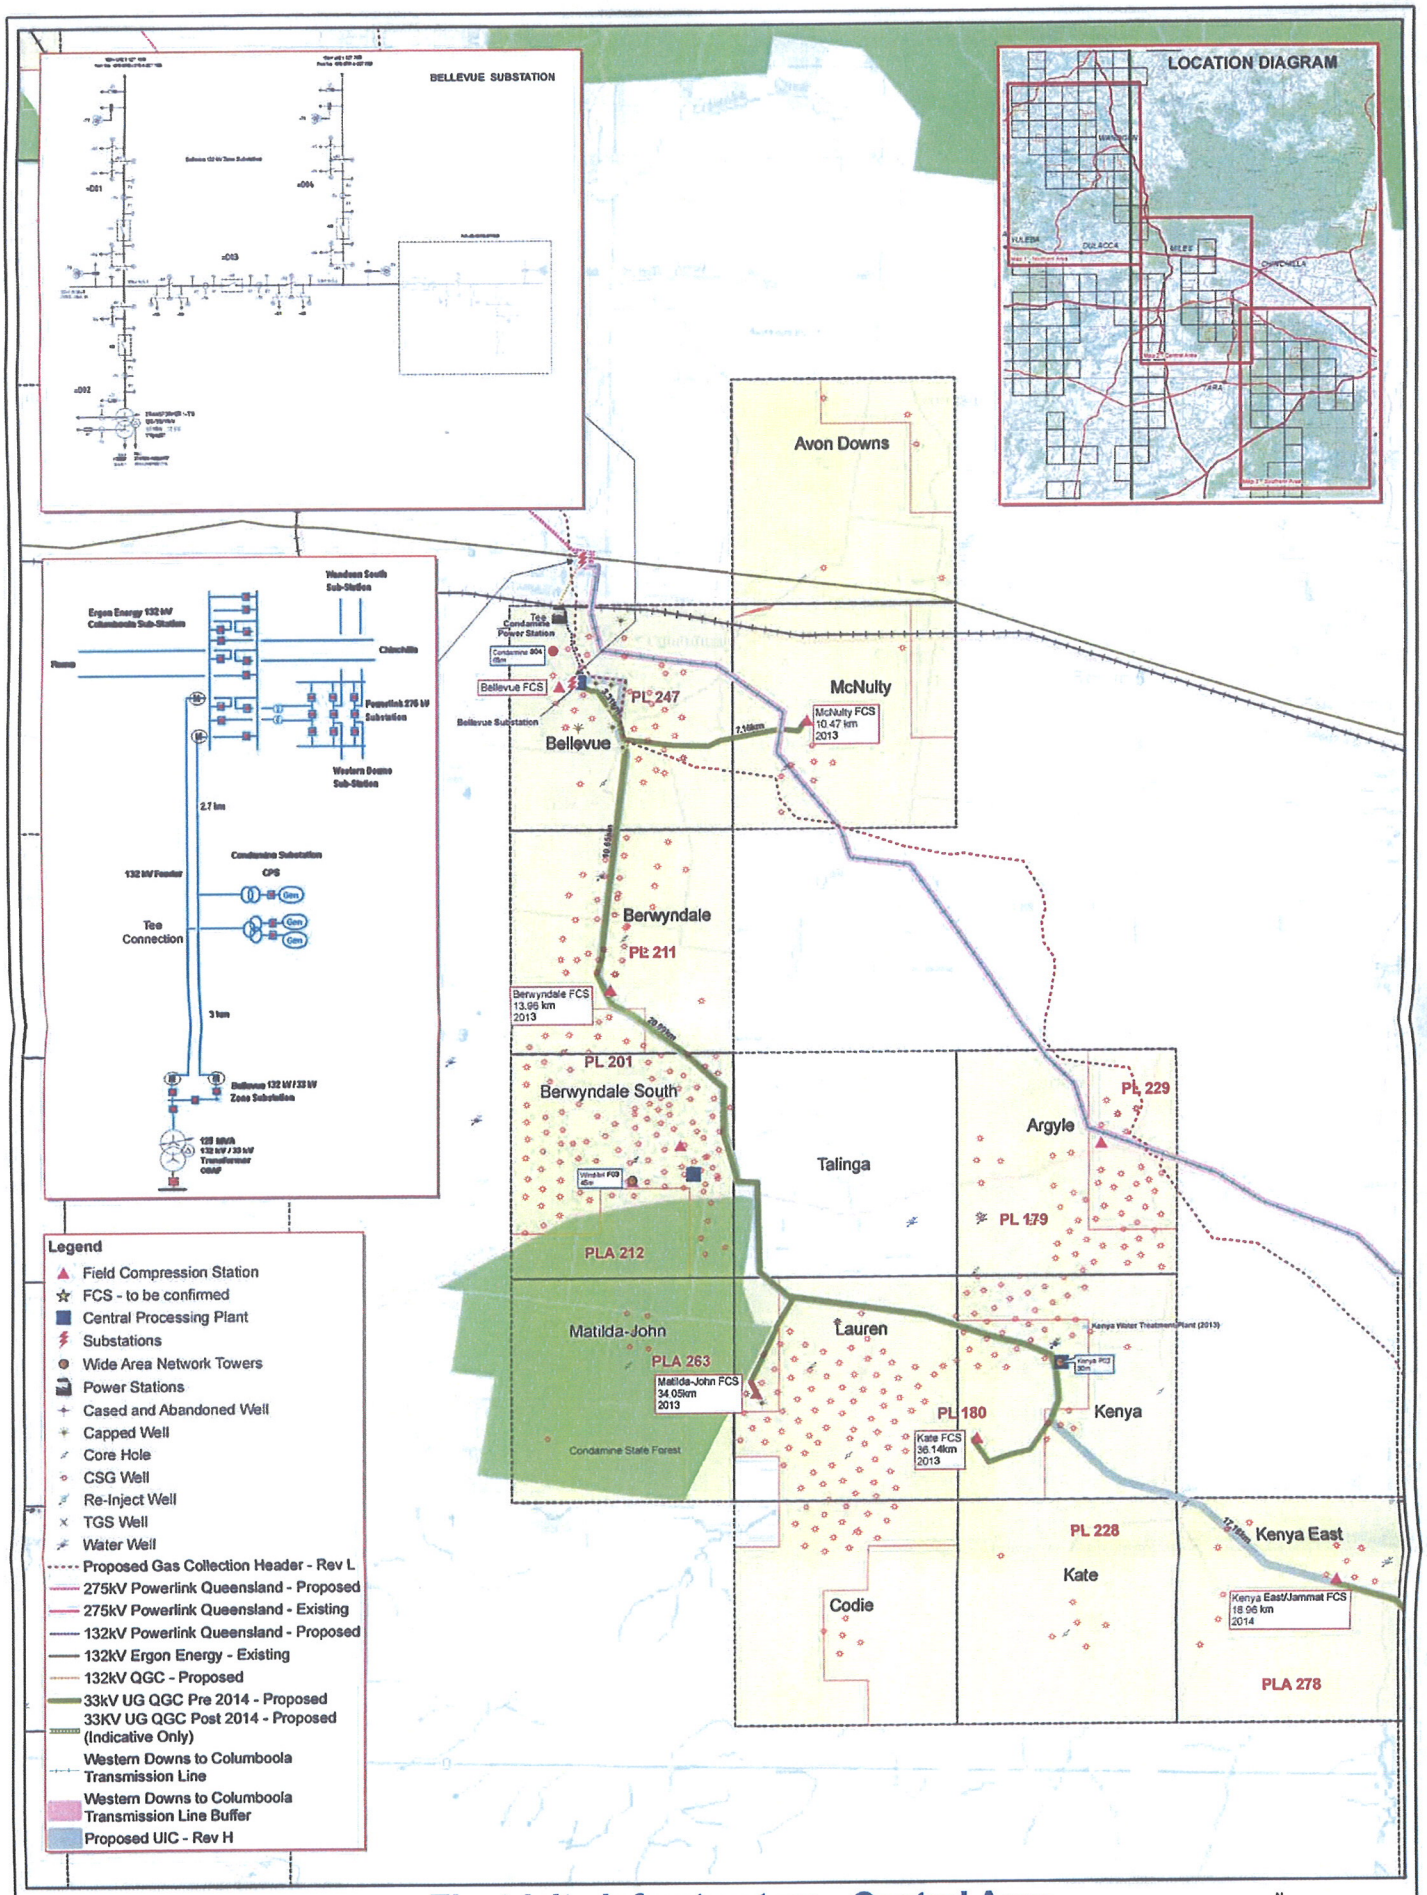
BELLEVUE SUBSTATION
LOCATION DIAGRAM
Avon Downs
McNulty
McNulty FCS
10.47 km
2013
Bellevue
Bellevue FCS
Bellevue Substation
PL 247
Berwyndale
PL 211
Berwyndale FCS
13.96 km
2013
PL 201
Berwyndale South
PLA 212
Talinga
Argyle
PL 229
PL 179
Matilda-John
PLA 263
Matilda-John FCS
34.05km
2013
Condamine State Forest
Lauren
PL 180
Kate FCS
36.14km
2013
Kenya
Kate
PL 228
Codie
Kenya East
Kenya East/Jammat FCS
18.96 km
2014
PLA 278
Legend
Field Compression Station
FCS - to be confirmed
Central Processing Plant
Substations
Wide Area Network Towers
Power Stations
Cased and Abandoned Well
Capped Well
Core Hole
CSG Well
Re-Inject Well
TGS Well
Water Well
Proposed Gas Collection Header - Rev L
275kV Powerlink Queensland - Proposed
275kV Powerlink Queensland - Existing
132kV Powerlink Queensland - Proposed
132kV Ergon Energy - Existing
132kV QGC - Proposed
33kV UG QGC Pre 2014 - Proposed
33KV UG QGC Post 2014 - Proposed (Indicative Only)
Western Downs to Columboola Transmission Line
Western Downs to Columboola Transmission Line Buffer
Proposed UIC - Rev H
Electricity Infrastructure - Central Area
QGC PL/PLA
QGC Field
State Forest
QGC
A BG Group business
N
0 3 6 9
Kilometres
SCALE: 1:100,000 (A1)